


* IF SEPARATE FIRE SPRINKLER METER REQUIRED, SEE STANDARD DRAWING 1-2A. (DEDICATED RESIDENTIAL FIRE SERVICE CONNECTION)

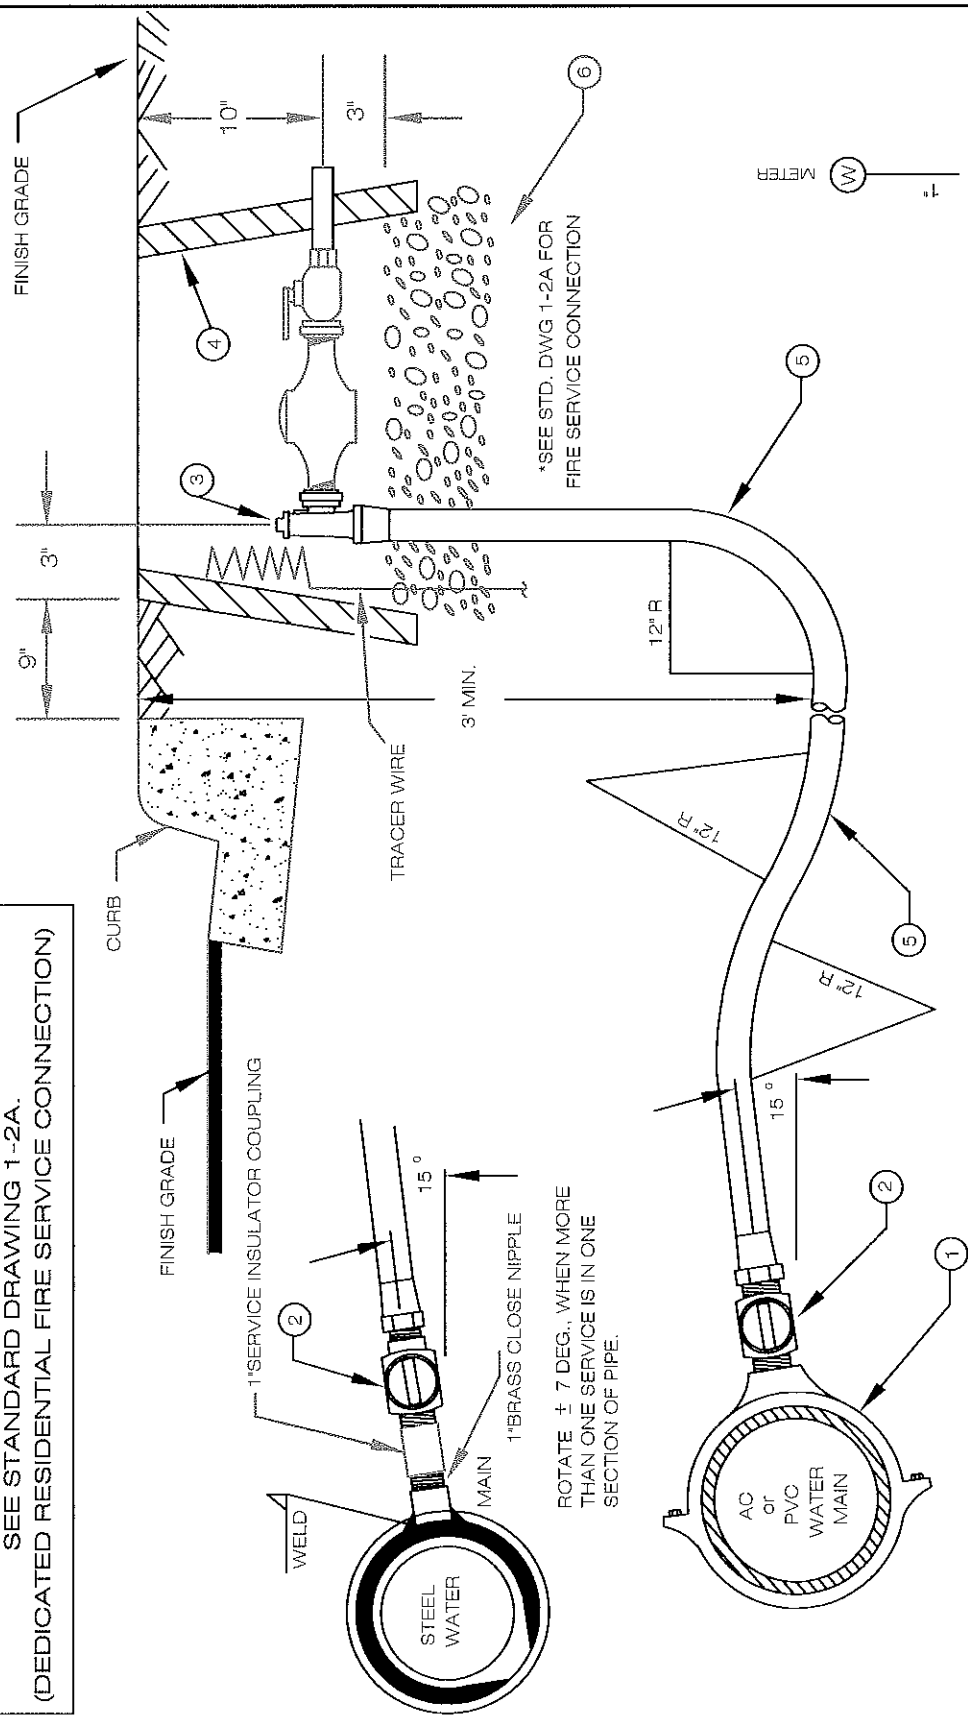

NOTES

LEGEND ON PLANS

- 1 DOUBLE STRAP BRONZE SERVICE SADDLE ON A.C. PIPE BRONZE OR BRASS SADDLE WITH STAINLESS STEEL FOUR BOLT STRAPS FOR PVC BRONZE CORPORATION STOP (INSTALL WITH KEY ON SIDE AND OPEN TAP).
- 2 BRONZE ANGLE SERVICE STOP WITH LOCKING DEVICE AND METER COUPLING.
- 3 METER BOX (SEE STD. DWG. 1-4 FOR LOCATION) METER BOX LOCATED IN TRAVELED WAYS, PAVED AREAS, AND SIDEWALKS SHALL BE CONCRETE, ALL OTHERS SHALL BE PLASTIC.
- 4 USE TYPE "K" COPPER TUBING FOR 1" SERVICE. (NO INTERMEDIATE JOINTS PERMITTED)
- 5 3/8" ROCK. (4" TO 6") DEEP

- A) INSTALL CATHODIC PROTECTION PER STD. DWG. 8-14
- B) ALL WATER METER OUTLETS SHALL BE LOCATED WITHIN LANDSCAPED AREAS. PLACEMENT OF OUTLETS IN PAVED AREAS REQUIRE PRIOR APPROVAL & SHALL BE IDENTIFIED ON THE IMPROVEMENT PLANS WITH THE SYMBOL. *
- C) INSTALL WARNING IDENTIFICATION TAPE

REVISIONS	APPROVED	DATE
UPDATED	B. SMITH	03/25/11

VISTA IRRIGATION DISTRICT

1" WATER SERVICE

Brian Smith 3/25/11
 BRIAN SMITH DATE
 R.C.E. 39926
 STD. DWG. 1-1