


IF SEPARATE FIRE SPRINKLER METER REQUIRED
SEE STANDARD DRAWING 1-2A
(DEDICATED RESIDENTIAL FIRE SERVICE CONNECTION)

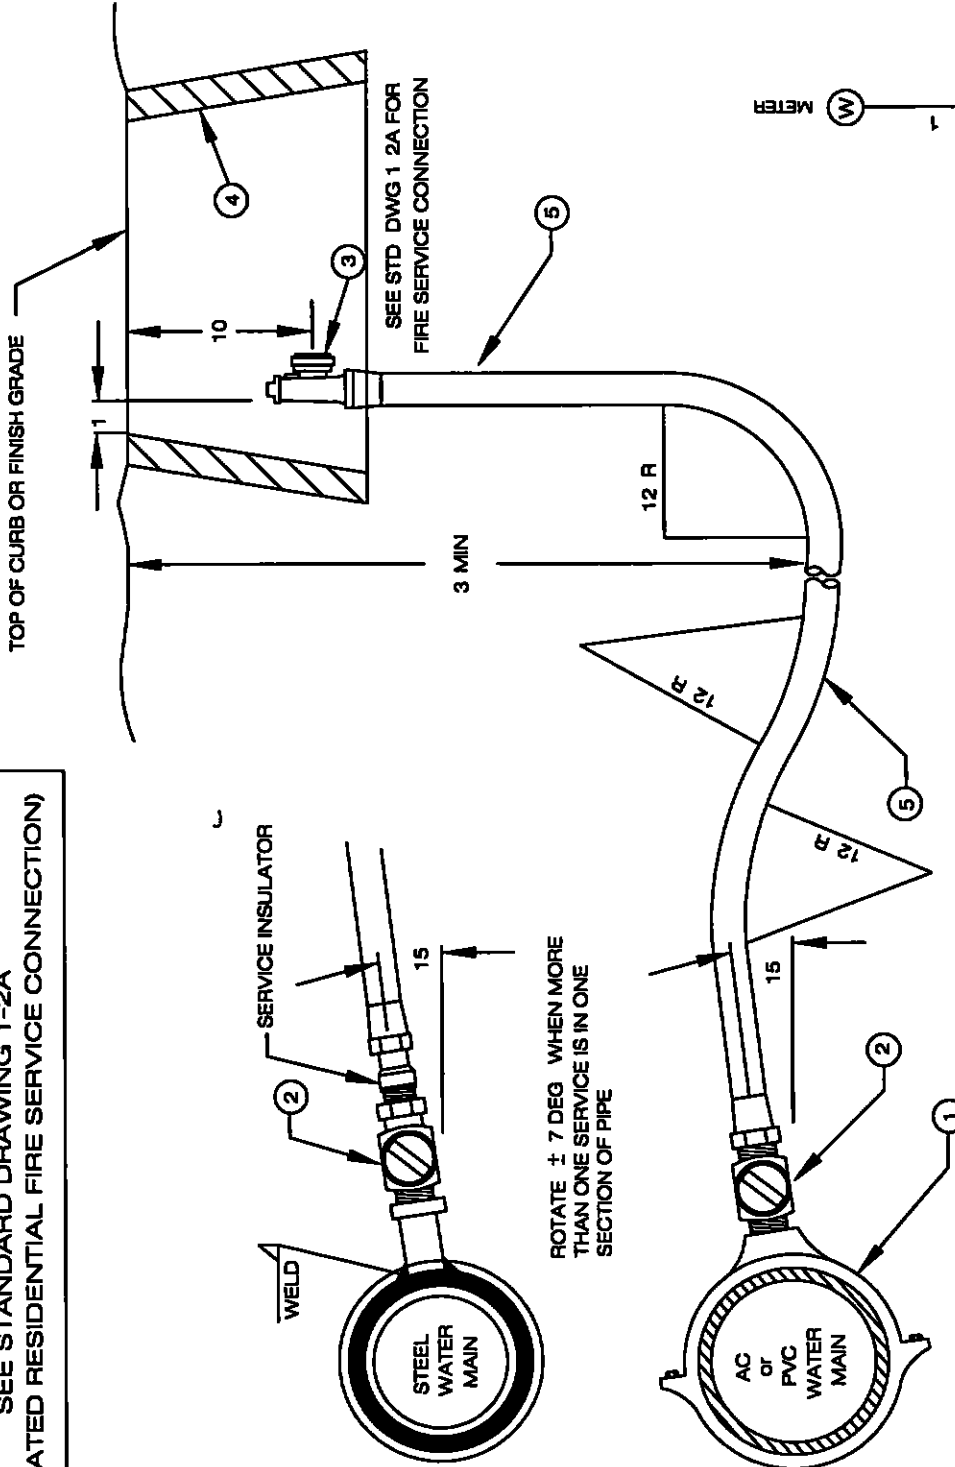

LEGEND ON PLANS

NOTES

- A) SILVER SOLDER JOINTS REQUIRED
- B) INSTALL CATHODIC PROTECTION PER STD DWG 6 14
- C) ALL WATER METER OUTLETS SHALL BE LOCATED WITHIN LANDSCAPED AREAS. PLACEMENT OF OUTLETS IN PAVED AREAS REQUIRE PRIOR APPROVAL & SHALL BE IDENTIFIED ON THE IMPROVEMENT PLANS WITH THE SYMBOL *
- D) (W) LEGEND ON PLANS

- 1) SINGLE BRONZE SERVICE CLAMP ON AC PIPE FULL CIRCLE BODY CLAMP ON PVC PIPE
- 2) BRONZE CORPORATION STOP (INSTALL WITH KEY ON SIDE AND OPEN TAP)
- 3) BRONZE ANGLE SERVICE STOP WITH LOCKING DEVICE AND METER COUPLING
- 4) METER BOX (SEE STD DWG 1 4 FOR LOCATION) METER BOX LOCATED IN TRAVELED WAYS PAVED AREAS AND SIDEWALKS SHALL BE CONCRETE ALL OTHERS SHALL BE PLASTIC
- 5) USE TYPE K COPPER TUBING FOR 1 SERVICE (NO INTERMEDIATE JOINTS PERMITTED)

LAST DRAWING APPROVAL DATE	12 / 02 / 99

VISTA IRRIGATION DISTRICT

1 WATER SERVICE

PATH Z ENGINEERING/TOM/STD DWGS/1 1 DWG

REVISED JULY 17 2003

JOHN AMODEO
R C E 31161

DATE

John Amodeo 9/26/03

STANDARD DRAWING 1-1