



CONDITION A-FIRE CONNECTION WITHIN PUBLIC RIGHT OF WAY

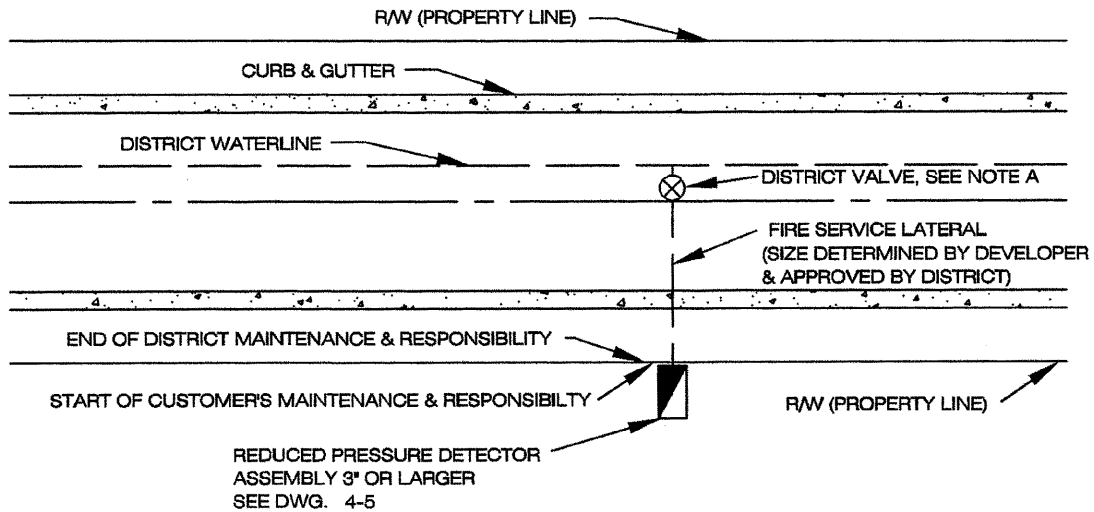

CONDITION B-FIRE CONNECTION WITHIN DISTRICT EASEMENT

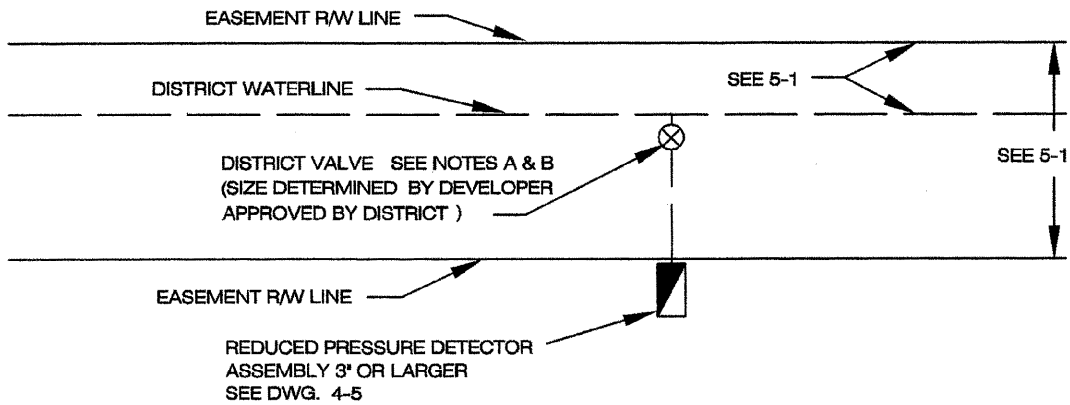

NOTE

- A DISTRICT VALVE TO BE OPERATED SOLELY BY DISTRICT. CUSTOMER TO NOTIFY DISTRICT TO CLOSE VALVE WHEN REQUIRED FOR MAINTENANCE OF CUSTOMER'S SYSTEM.
- B DISTRICT MAINTENANCE AND RESPONSIBILITY TERMINATES AT DOWNSTREAM SIDE OF VALVE AND CUSTOMER'S MAINTENANCE AND RESPONSIBILITY BEGINS.
- C DISTRICT WILL INSPECT UNDERGROUND INSTALLATION OF ALL FIRE CONNECTIONS BETWEEN DISTRICT GATE VALVE AND RPDC ASSEMBLY.
- D MATERIALS USED UP TO AND INCLUDING THE RPDC ASSEMBLY ARE TO MEET DISTRICT SPECIFICATIONS.

| REVISIONS | APPROVED | DATE | VISTA IRRIGATION DISTRICT | PATH: (TOM) H:\STDDWGS\4-4.DWG |
|-----------|----------|------|---------------------------------|---|
| | | | FIRE SERVICE CONNECTIONS | <i>John A. Amodeo</i> (2/2/97) JOHN AMODEO R. C. E. 31161 |
| | | | | DATE |
| | | | | STANDARD DRAWING 4-4 |
| ACAD | | 6/96 | | |