


- ① SUPPLY LINE (FOR DETAILS SEE DWG. 4-4)
- ② 90° ELBOW
- ③ SPOOL (CML&C)
- ④ ASSEMBLY SUPPORT
- ⑤ DISTRICT APPROVED RPD ASSEMBLY
- ⑥ CUSTOMER LINE
- ⑦ CONC. SPLASH PAD (MIN. 24" WIDE)

- ⑧ CONC. THRUST BLOCK PER 5-7
- ⑨ FIRE DEPT. CONNECTION, IF REQUIRED
- ⑩ TEST PORT
- ⑪ FLANGE OR FLANGE ADAPTER (FOR STEEL PIPE LINE, INSULATION KIT ASSEMBLY REQUIRED PER DWG. 8-10)
- ⑫ OS&Y R/W GATE VALVES

NOTE: ALL JOINTS CAN BE WELDED IN LIEU OF FLANGES

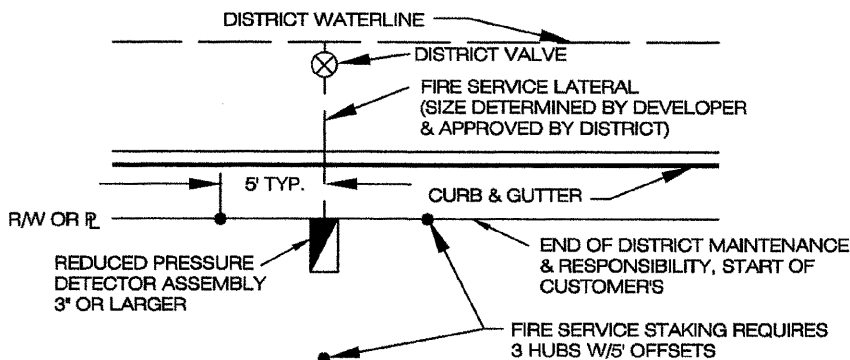

STAKING REQUIREMENTS FOR FIRE SERVICES

NOTES:

- 1 THE REDUCED PRESSURE DETECTOR ASSEMBLY SHALL BE SELECTED FROM THE APPROVED CALIFORNIA DEPT. OF HEALTH SERVICES LIST ON FILE WITH THE DISTRICT.
- 2 SPECIFIC INSTALLATION SHALL BE SUBMITTED TO DISTRICT FOR APPROVAL OF LOCATION OF DEVICE
- 3 PROPERTY OWNER IS RESPONSIBLE TO MAINTAIN AND REPAIR THE RPD, BY-PASS ASSEMBLY AND WATER METER.
- 4 PROPERTY OWNER IS REQUIRED TO HAVE THE DEVICE TESTED ANNUALLY BY A CERTIFIED TESTER, WITH A COPY OF THE RESULTS SENT TO DISTRICT.
- 5 METER REGISTER TO BE IN CUBIC FEET.
- 6 CONTACT FIRE DEPARTMENT FOR OTHER REQUIREMENTS.

"ALL INSTALLATIONS SHALL MEET THE MINIMUM REQUIREMENT OF THE UNIFORM PLUMBING CODE"

| | | | | |
|-----------|----------|------|---|---|
| REVISIONS | APPROVED | DATE | VISTA IRRIGATION DISTRICT | PATH: (TOM) H:\STDDWGS4-5.DWG |
| | | | FIRE SERVICE CONNECTION | JOHN AMODEO DATE R. C. E. 31161 |
| | | | REDUCED PRESSURE DETECTOR ASSEMBLY | |
| | | | 3" OR LARGER | |
| ACAD | | 6/96 | | STANDARD DRAWING 4-5 |